SAiGE Longlife Decking Ltd,

TEST REPORT

SCOPE OF WORK
Support Beam 50mm

REPORT NUMBER
200930008SHF-002

TEST DATE(S)
2020-09-30 - 2020-10-16

ISSUE DATE
2020-10-16

PAGES
5

DOCUMENT CONTROL NUMBER
LFT-APAC-SHF-OP-10k(May 1, 2020)
© 2020 INTERTEK

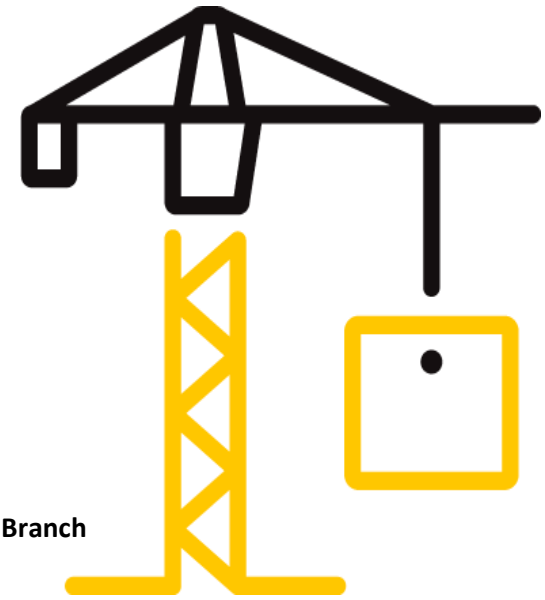

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch

Test Report

Statement

1.This report is invalid without company's special seal for testing on assigned page.

2.This report is invalid without authorized person's signature.

3.This report is invalid where any unauthorized modification indicated.

4.Don't copy this report in partial (except full copy) without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.

5.Any holder of this document is advised that this report is for the exclusive use of Intertek's Customer and is provided pursuant to the agreement between Intertek and its Customer. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. This report was made with due care within the limitation of a defined scope of work and on the basis of information, materials and instructions received from the Customer or its nominated third parties. Intertek is under no obligation to refer to or report upon any facts or circumstances which are outside the specific instructions received and accepts no responsibility to any parties whatsoever, following the issue of the report, for any matters arising outside the agreed scope of the works. The tests results are not intended to be a recommendation for any particular course of action. Customer is responsible for acting as it sees fit on the basis of such results.

6.Intertek's written consent is required to use Intertek's name or logo on the object, product or service being tested. The observations and test results in this report relate only to the sample under test. This report alone does not indicate that the item, product or service has passed any Intertek certification program.

7.The report was digital signed by Shang Hai, Intertek Group plc, please using Adobe Acrobat Reader to verify the authenticity.

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch
Plant 5, No. 6958 Daye Road, Fengxian District, Shanghai, China
Tel: 021-61136116 Fax: 021-61189921
Website: www.intertek.com

Test Report

Issue Date: 2020-10-16 Intertek Report No. 200930008SHF-002

Applicant: SAiGE Longlife Decking Ltd,

Address: Vicarage Barns, Lower Quinton, Stratford-upon-Avon, Warwickshire, CV37 8SG, United Kingdom

Attn: Harriet

Test Type: Performance test, samples provided by the applicant.

Product Information

Product Name	Support Beam 50mm	**Brand**	/
Sample Description	Good Condition	**Sample Amount**	16 pcs
		Received Date	2020-09-28

Sample ID	**Model**	**Specification**
S200930008SHF.002	SB5-0050	50x50

Test Methods And Standards

Test Standard	With reference to Section 4 of CISCA Recommended Test Procedures for Access Floors 2007
Specification Standard	/
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

Note:

1.This report relates specifically to the sample(s) that were drawn and provided by the applicant or their nominated third party. The reported result(s) provide no warranty or verification on the sample(s) representing any specific goods and/or shipment and only relate to the sample(s) as received and tested.

Report Authorized

Daniel Zhang Jackie Zhou

Name: Daniel Zhang Name: Jackie Zhou

Title: Reviewer Title: Project Engineer

Test Report

Issue Date: 2020-10-16 Intertek Report No. 200930008SHF-002

Test Items, Method and Results:

Test Item: Stringer load test

Test Method: With reference to Section 4 of CISCA Recommended Test Procedures for Access Floors 2007

Test Procedure:

The stringers were tested according to Section 4 of CISCA Recommended Test Procedures for Access Floors 2007. The loads were applied vertically at mid span of the stringer through a steel indentor 1''(25.4 mm) square.

Test Result:

Test Items	Test Span	Ultimate Load(N)		
		Sample 1	Sample 2	Average value
Stringer load test	600mm	11892	11796	11844
	800mm	8601	8762	8682
	1000mm	6877	6739	6808
	1200mm	5585	5581	5583

Test Photo:

In test

Test Report

Issue Date: 2020-10-16 Intertek Report No. 200930008SHF-002

Appendix A: Sample Received Photo

Front View(Test surface)

Back View

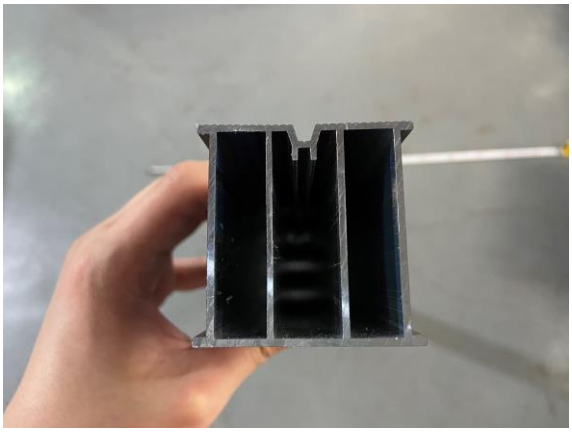

Section View

Revision:

NO.	Date	Changes	Author	Reviewer
200930008SHF-002	2020-10-16	First issue	Jackie Zhou	Daniel Zhang