

# SAiGE Longlife Decking Ltd,

# **TEST REPORT**

#### **SCOPE OF WORK**

Pedestal assy 485-775

#### **REPORT NUMBER**

210511021SHF-010

#### **TEST DATE(S)**

2021-05-11 - 2021-05-24

#### **ISSUE DATE**


2021-05-24

#### **PAGES**

6

#### **DOCUMENT CONTROL NUMBER**

LFT-APAC-SHF-OP-10k(May 1, 2021) © 2021 INTERTEK



Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch





Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch
Plant 5, No. 6958 Daye Road, Fengxian District, Shanghai, China
Tel: 021-61136116 Fax: 021-61189921

Website: www.intertek.com

## **Test Report**

### **Statement**

- 1. This report is invalid without company's special seal for testing on assigned page.
- 2. This report is invalid without authorized person's signature.
- 3. This report is invalid where any unauthorized modification indicated.
- 4.Don't copy this report in partial (except full copy) without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.

5.Any holder of this document is advised that this report is for the exclusive use of Intertek's Customer and is provided pursuant to the agreement between Intertek and its Customer. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. This report was made with due care within the limitation of a defined scope of work and on the basis of information, materials and instructions received from the Customer or its nominated third parties. Intertek is under no obligation to refer to or report upon any facts or circumstances which are outside the specific instructions received and accepts no responsibility to any parties whatsoever, following the issue of the report, for any matters arising outside the agreed scope of the works. The tests results are not intended to be a recommendation for any particular course of action. Customer is responsible for acting as it sees fit on the basis of such results.

6.Intertek's written consent is required to use Intertek's name or logo on the object, product or service being tested. The observations and test results in this report relate only to the sample under test. This report alone does not indicate that the item, product or service has passed any Intertek certification program.

7. The report was digital signed by Shang Hai, Intertek Group plc, please using Adobe Acrobat Reader to verify the authenticity.





Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch Plant 5, No. 6958 Daye Road, Fengxian District, Shanghai, China Tel: 021-61136116 Fax: 021-61189921

Website: www.intertek.com

# **Test Report**

Issue Date: 2021-05-24 Intertek Report No. 210511021SHF-010

Applicant: SAiGE Longlife Decking Ltd,

Address: Vicarage Barns, Lower Quinton, Stratford-upon-Avon, Warwickshire, CV37 8SG, United Kingdom

Attn: Harriet

Test Type: Performance test, samples provided by the applicant.

#### **Product Information**

Product Name	Pedestal assy 485-775		Brand	Saige
Sample		Good Condition	Sample Amount	3 pcs
Description		Good Condition	Received Date	2021-05-07
Sample ID		Model	Specification	
S210511021SHF.001		PED-EX4-FR	485-775	

#### **Test Methods And Standards**

Test Standard	With reference to Section 5 of CISCA Recommended Test Procedures for Access Floors 2007
Specification Standard	/
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

#### Note:

1. This report relates specifically to the sample(s) that were drawn and provided by the applicant or their nominated third party. The reported result(s) provide no warranty or verification on the sample(s) representing any specific goods and/or shipment and only relate to the sample(s) as received and tested.

Report Authorized

Name: Daniel Zhan

Title: Approver

Flora Fan

Mile: Reviewer

Jackie Zhou

Name: Jackie Zhou Title: Project Engineer



# **Test Report**

Issue Date: 2021-05-24 Intertek Report No. 210511021SHF-010

#### **Test Items, Method and Results:**

Test Item: Pedestal axial load test

Test Method: With reference to Section 5 of CISCA Recommended Test Procedures for Access Floors 2007

Test Procedure:

Pedestals were tested according to Section 5 of CISCA Recommended Test Procedures for Access Floors 2007. Aligh the pedestal assembly in the testing apparatus and apply an increasing load centered on the pedestal until reached to the maximum load, then record the load and inspected the tested sample.

#### **Results:**

Pedestal	Ultimate Load (N)	
1	11459	
2	10230	
3	10522	
Average	10737	

#### Test Photo:




In test



# **Test Report**

Issue Date: 2021-05-24 Intertek Report No. 210511021SHF-010

#### **Drawings:**

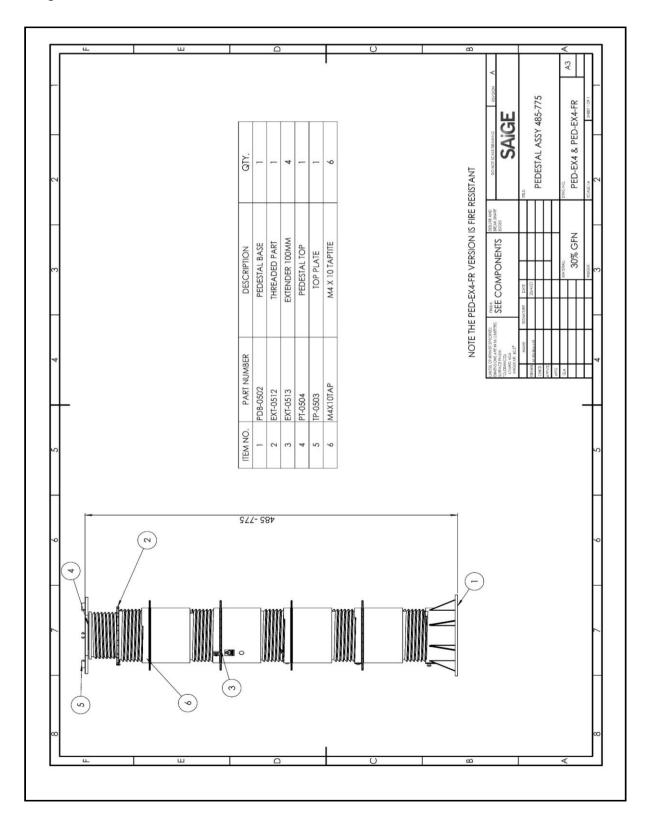





# **Test Report**

Issue Date: 2021-05-24 Intertek Report No. 210511021SHF-010

#### **Appendix A: Sample Received Photo**



#### **Revision:**

NO.	Date	Changes
210511021SHF-010	2021-05-24	First issue

